

# FM-200 Component Description


Effective: July 1999

K-90-2110

## Liquid Level Indicator

### Features

- For use with UL listed, ULC listed & FMRC approved systems
- See Kidde Manual 90-FM 200M-021 for USCG approval

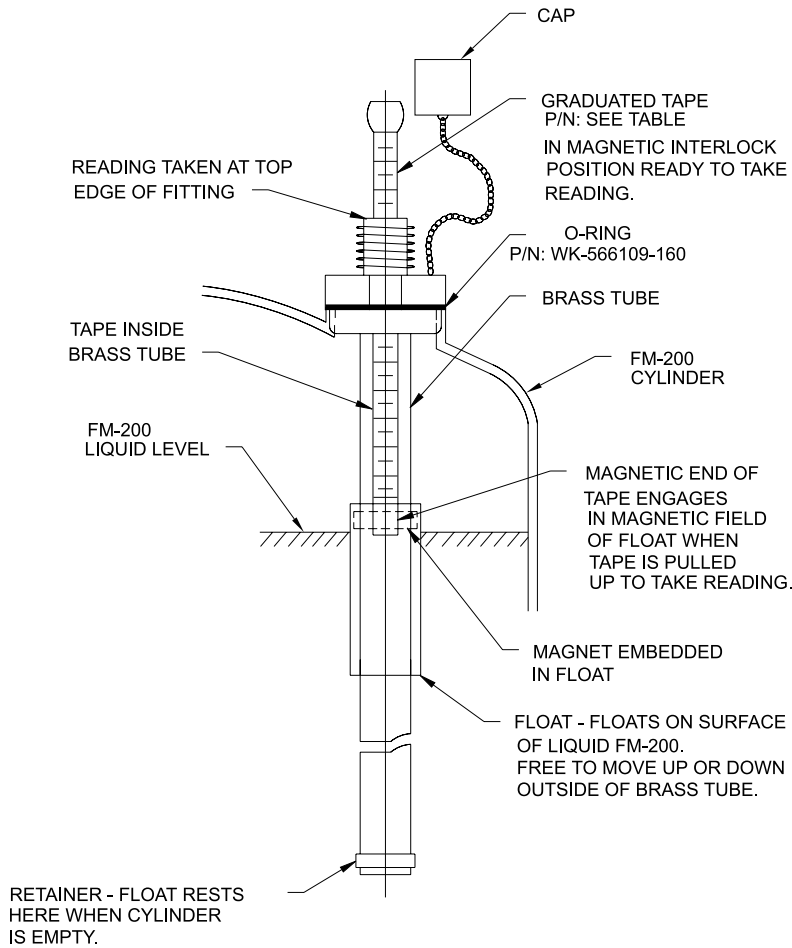

### ORDERING INFORMATION

CYLINDER	LLI TAPE P/N
125	235681
200	283894
350	283894
600	283894

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to perform as described herein.

If you need more information on this product, or if you have a question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. (508) 881-2000.

K-90-2110 4/99 ©1999 Kidde-Fenwal, Inc. Printed in U.S.A.

**KIDDE**<sup>®</sup>  
Fire Systems

KIDDE-FENWAL, INC.  
400 MAIN STREET, ASHLAND, MA 01721  
TEL: (508) 881-2000 FAX: (508) 881-8920