

FM-200 Component Description


Effective: April 1999

K-90-2120

Flexible Discharge Hoses

Features

- For use with UL listed, ULC listed & FMRC approved systems
- See KIDDE Manual 90-FM200M-021 for USCG approval

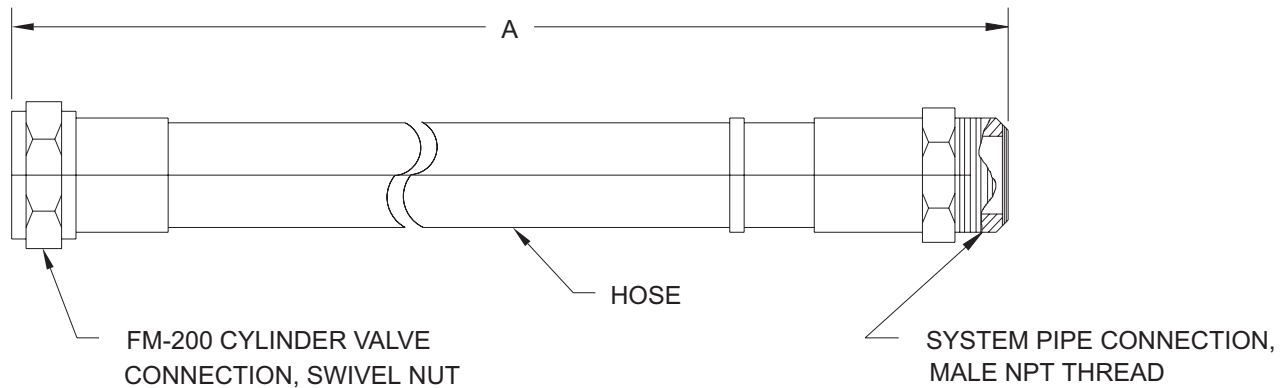

ORDERING INFORMATION

PART NO.	MALE NPT	A	MIN. BED RADIUS
283898	1-1/2	24	10.5
283899	2	31	13.5
283900	2-1/2	48	22.5

* DIMENSIONS ARE IN INCHES

MATERIALS

HOSE: REINFORCED RUBBER HOSE
FITTING: BRASS

MINIMUM BURSTING PRESSURE: 2000 PSI
WORKING PRESSURE: 500 PSI
PROOF PRESSURE: 1000 PSI

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to perform as described herein.

If you need more information on this product, or if you have a question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. (508) 881-2000.

K-90-2120 4/99 ©1999 Kidde-Fenwal, Inc. Printed in U.S.A.

 **KIDDE**[®]
Fire Systems

KIDDE-FENWAL, INC.
400 MAIN STREET, ASHLAND, MA 01721
TEL: (508) 881-2000 FAX: (508) 881-8920

 **KIDDE**[®] Fire Systems