

FM-200 Component Description


Effective: April 1999

K-90-6030M

Cable Housings for Cable Operated Control Heads

Features

- See KIDDE Manual 90-FM200M-021 for USCG approval

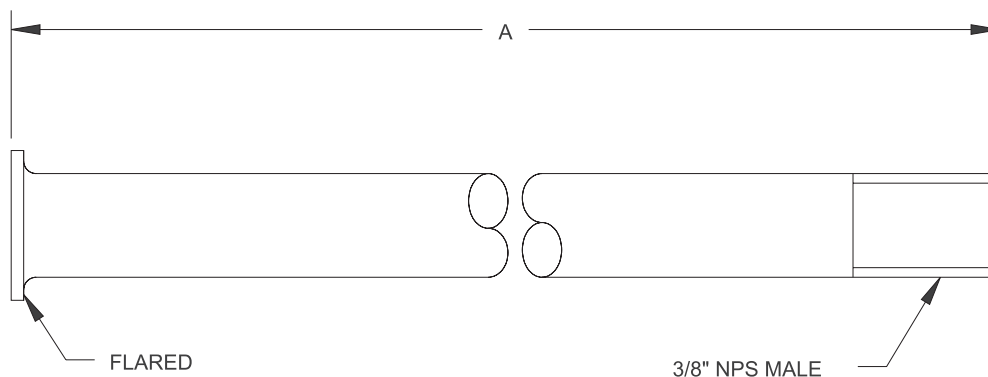

| PART NUMBER | CYLINDERS USED WITH | | CYLINDER CENTERS | | "A" DIMENSION | |
|------------------------|---------------------|-----------|------------------|-----|---------------|-----|
| | LBS | KG | IN | mm | IN | mm |
| MARINE CO ₂ | | | | | | |
| 33157 | 50 | 22.6 | 9.5 | 241 | 5.12 | 130 |
| FM-200 | | | | | | |
| 260702 | 125-200 | 56.7-90.7 | 15.0 | 381 | 10.6 | 270 |
| 260951 | 350 | 158.7 | 18.0 | 457 | 13.6 | 346 |
| 263602 | 600 | 272.1 | 24.0 | 610 | 19.6 | 498 |

MATERIAL: BRASS .625" (16MM) O.C. X .049" (1.28MM) WALL

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to perform as described herein.

If you need more information on this product, or if you have a question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. (508) 881-2000.

K-90-6030M 4/99 ©1999 Kidde-Fenwal, Inc. Printed in U.S.A.

KIDDE®
Fire Systems

KIDDE-FENWAL, INC.
400 MAIN STREET, ASHLAND, MA 01721
TEL: (508) 881-2000 FAX: (508) 881-8920