


FE-13 Component Description

Effective: July 1999

FE-13 Container Assemblies

K-96-9000

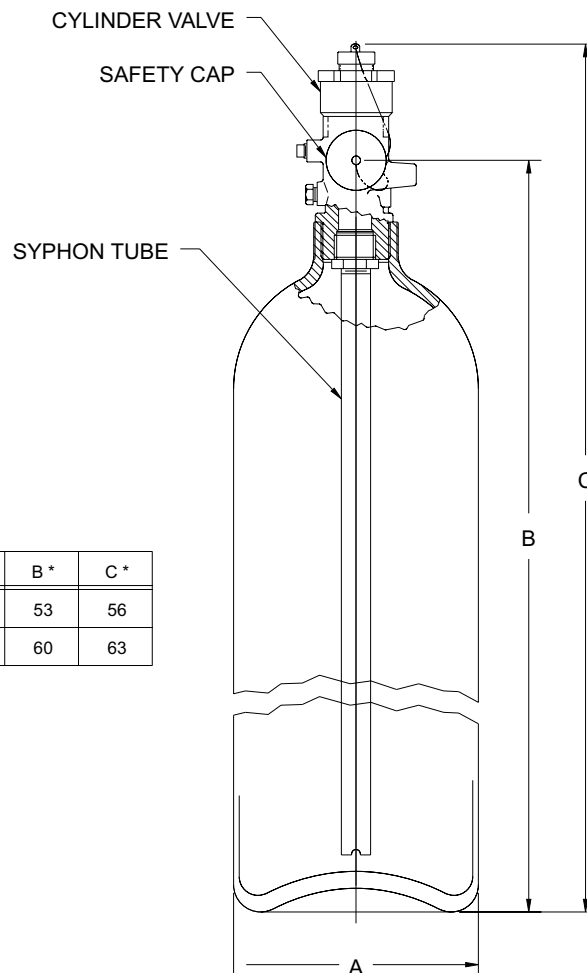

PART No.	CYL. SIZE	A *	B *	C *
96-100065-001	74#	9	53	56
96-100112-001	115#	10.5	60	63

*DIMENSIONS ARE IN INCHES

MATERIALS

VALVE BODY: BRASS

CYLINDER: STEEL, PAINTED RED

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to perform as described herein.

If you need more information on this product, or if you have a question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. (508) 881-2000.

K-96-9000 7/99 ©1999 Kidde-Fenwal, Inc. Printed in U.S.A.

NOTES:

1. THE SAFETY CAP MUST BE INSTALLED ON THE VALVE OUTLET AT ALL TIMES EXCEPT WHEN THE CYLINDERS ARE CONNECTED TO THE SYSTEM PIPING OR BEING FILLED. THE SAFETY CAP MUST NOT BE REMOVED FROM ITS CHAIN.
2. SEE K-96-9010 FOR ADDITIONAL INFORMATION.
3. CYLINDERS ARE VERTICAL MOUNT ONLY.

 **KIDDE**[®]
Fire Systems

KIDDE-FENWAL, INC.
400 MAIN STREET, ASHLAND, MA 01721
TEL: (508) 881-2000 FAX: (508) 881-8920